

Aberdeen Fire Dept




Aberdeen, WA

This report was generated on 12/7/2021 8:29:04 AM

Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 10/01/2021 | End Date: 10/31/2021

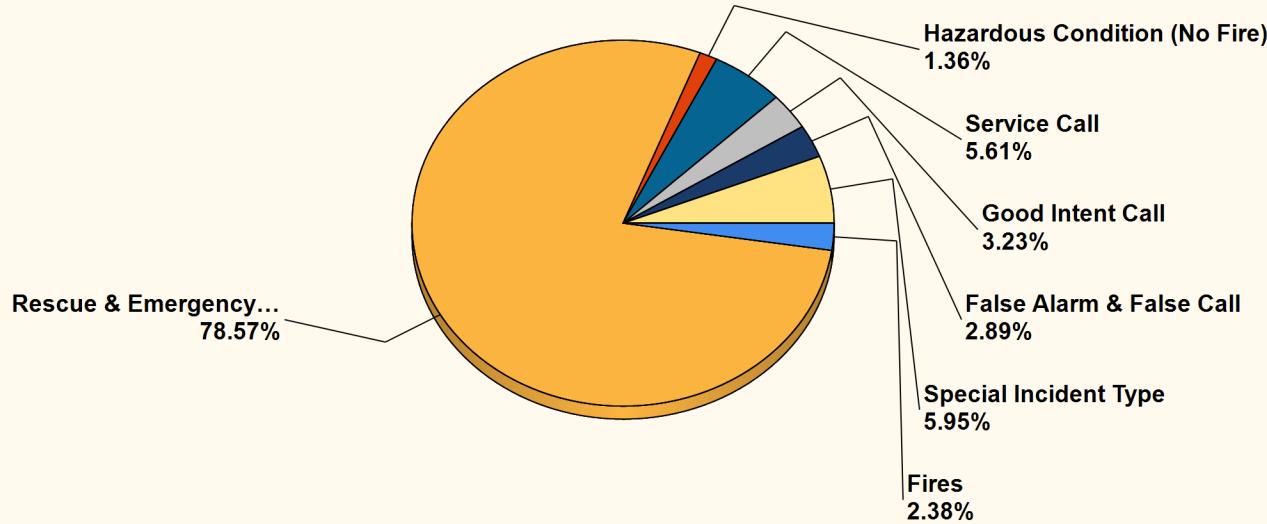

MAJOR INCIDENT TYPE	# INCIDENTS	% of TOTAL
Fires	14	2.38%
Rescue & Emergency Medical Service	462	78.57%
Hazardous Condition (No Fire)	8	1.36%
Service Call	33	5.61%
Good Intent Call	19	3.23%
False Alarm & False Call	17	2.89%
Special Incident Type	35	5.95%
TOTAL	588	100%

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.

Detailed Breakdown by Incident Type

INCIDENT TYPE	# INCIDENTS	% of TOTAL
111 - Building fire	5	0.85%
118 - Trash or rubbish fire, contained	5	0.85%
131 - Passenger vehicle fire	1	0.17%
150 - Outside rubbish fire, other	2	0.34%
154 - Dumpster or other outside trash receptacle fire	1	0.17%
300 - Rescue, EMS incident, other	1	0.17%
320 - Emergency medical service, other	1	0.17%
321 - EMS call, excluding vehicle accident with injury	444	75.51%
322 - Motor vehicle accident with injuries	3	0.51%
324 - Motor vehicle accident with no injuries.	13	2.21%
412 - Gas leak (natural gas or LPG)	4	0.68%
413 - Oil or other combustible liquid spill	3	0.51%
424 - Carbon monoxide incident	1	0.17%
500 - Service Call, other	2	0.34%
520 - Water problem, other	1	0.17%
531 - Smoke or odor removal	1	0.17%
550 - Public service assistance, other	15	2.55%
553 - Public service	2	0.34%
561 - Unauthorized burning	12	2.04%
600 - Good intent call, other	2	0.34%
611 - Dispatched & cancelled en route	10	1.7%
621 - Wrong location	1	0.17%
622 - No incident found on arrival at dispatch address	2	0.34%
651 - Smoke scare, odor of smoke	1	0.17%
653 - Smoke from barbecue, tar kettle	2	0.34%
671 - HazMat release investigation w/no HazMat	1	0.17%
700 - False alarm or false call, other	1	0.17%
710 - Malicious, mischievous false call, other	1	0.17%
730 - System malfunction, other	2	0.34%
731 - Sprinkler activation due to malfunction	1	0.17%
733 - Smoke detector activation due to malfunction	1	0.17%
743 - Smoke detector activation, no fire - unintentional	5	0.85%
745 - Alarm system activation, no fire - unintentional	6	1.02%
900 - Special type of incident, other	35	5.95%
TOTAL INCIDENTS:	588	100%

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.